

**DRF240-24-1**

**TEST DATA**

**IEC61000 SERIES**

**INDEX**

	PAGE
1. Electrostatic Discharge Immunity Test (IEC61000-4-2) .....	R-1
2. Radiated Radio-Frequency Electromagnetic Field Immunity Test (IEC61000-4-3) .....	R-2
3. Electrical Fast Transient / Burst Immunity Test (IEC61000-4-4) .....	R-3
4. Surge Immunity Test (IEC61000-4-5) .....	R-4
5. Conducted Disturbances Induced by Radio-Frequency Field Immunity Test (IEC61000-4-6) .....	R-5
6. Power Frequency Magnetic Field Immunity Test (IEC61000-4-8) .....	R-6
7. Voltage Dips, Short Interruptions Immunity Test (IEC61000-4-11) .....	R-7

Terminology used

FG.....Frame GND

※ Test results are reference data based on our standard measurement condition.

**1. Electrostatic Discharge Immunity Test (IEC61000-4-2)**

**MODEL : DRF240-24-1**

**(1) Equipment Used**


Electrostatic Discharge Simulator : NSG435 (SCHAFFNER)  
 Discharge Resistance : 330Ω Capacitor : 150pF

**(2) Test Conditions**

Input Voltage : 230VAC Output Voltage : Rated  
 Output Current : 100% Polarity : +, -  
 Number of Tests : 10 times Ambient Temperature : 25°C  
 Discharge Interval : >1 Second

**(3) Test Method and Device Test Point**

Contact Discharge : FG terminal, Chassis  
 Air Discharge : Input terminal, Output terminal

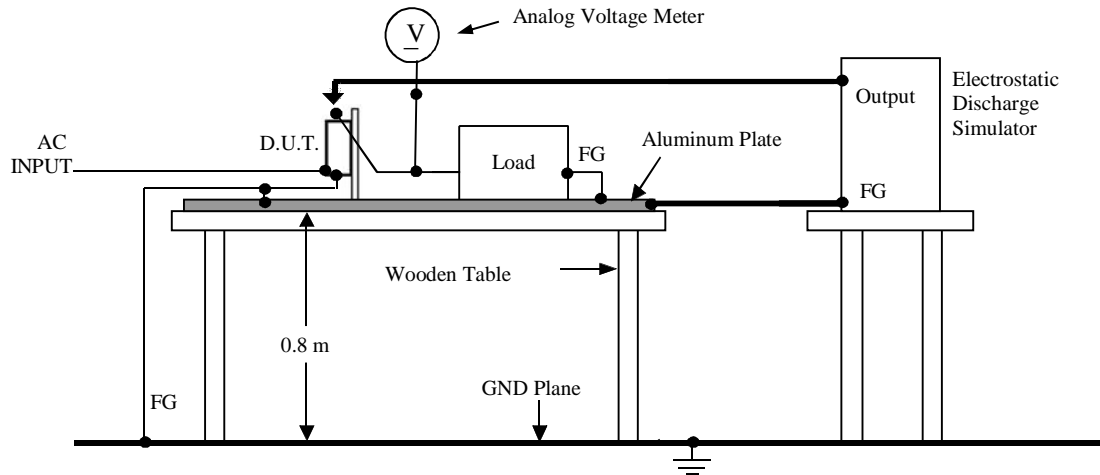

**(4) Acceptable Conditions**

1. Output voltage regulation not to exceed  $\pm 5\%$  of initial (before test) value during test.
2. Output voltage to be within regulation specification after the test.
3. Along with 1 and 2, no discharge of fire or smoke, as well as no output failure.

**(5) Test Result**

Contact Discharge (kV)	DRF240-24-1	Air Discharge (kV)	DRF240-24-1
2	PASS	4	PASS
4	PASS	8	PASS

**2. Radiated Radio-Frequency Electromagnetic Field Immunity Test (IEC6100-4-3)**

**MODEL : DRF240-24-1**


**(1) Equipment Used**

AR Laser Powered Field Probe (100k-6GHz)	: FL7006
Teseq Bilog Antenna (26-3000Mhz)	: CBL 6144
Agilent Signal Generator (9k-3200MHz)	: 8648C
Agilent EPM Series Power Meter	: E4419B
Schaffner Power Amplifier (80MHz-1GHz)	: CBA9433

**(2) Test Conditions**

Input Voltage	: 230VAC	Output Voltage	: Rated
Output Current	: 100%	Amplitude Modulated	: 80%, 1kHz
Electromagnetic Frequency	: 80~1000MHz	Ambient Temperature	: 25°C
Distance	: 3.0m	Wave Angle	: Horizontal and Vertical
Sweep Conditions	: 1.0% Step Up, 2.8 Seconds Hold		
Test Angle	: Top, Bottom, Left, Right, Front, Back		

**(3) Test Method and Device Test Point**

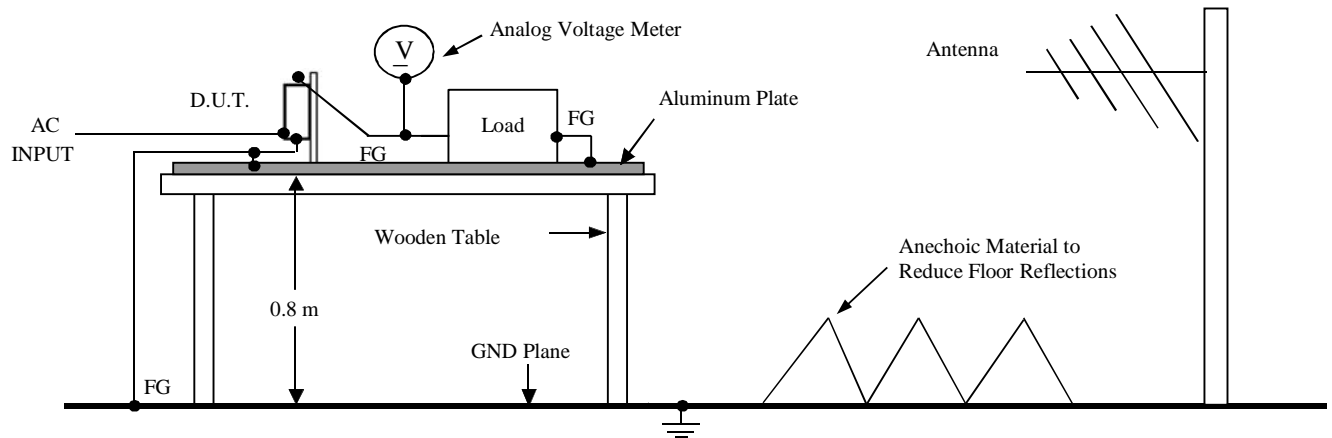

**(4) Acceptable Conditions**

1. Output voltage regulation not to exceed  $\pm 5\%$  of initial (before test) value during test.
2. Output voltage to be within regulation specification after the test.
3. Along with 1 and 2, no discharge of fire or smoke, as well as no output failure.

**(5) Test Result**

Radiation Field Strength (V/m)	DRF240-24-1
10	PASS

**3. Electrical Fast Transient / Burst Immunity Test (IEC61000-4-4)**

**MODEL : DRF240-24-1**

**(1) Equipment Used**


EFT/B Generator : EFT 6501 (SCHAFFNER)

**(2) Test Conditions**

Input Voltage	: 230VAC	Output Voltage	: Rated
Output Current	: 100%	Polarity	: +, -
Number of Tests	: 3 times	Ambient Temperature	: 25°C
Test time	: 1 minute		

**(3) Test Method and Device Test Point**

Apply to (N, L, FG), (N, L), (N), (L), (FG)

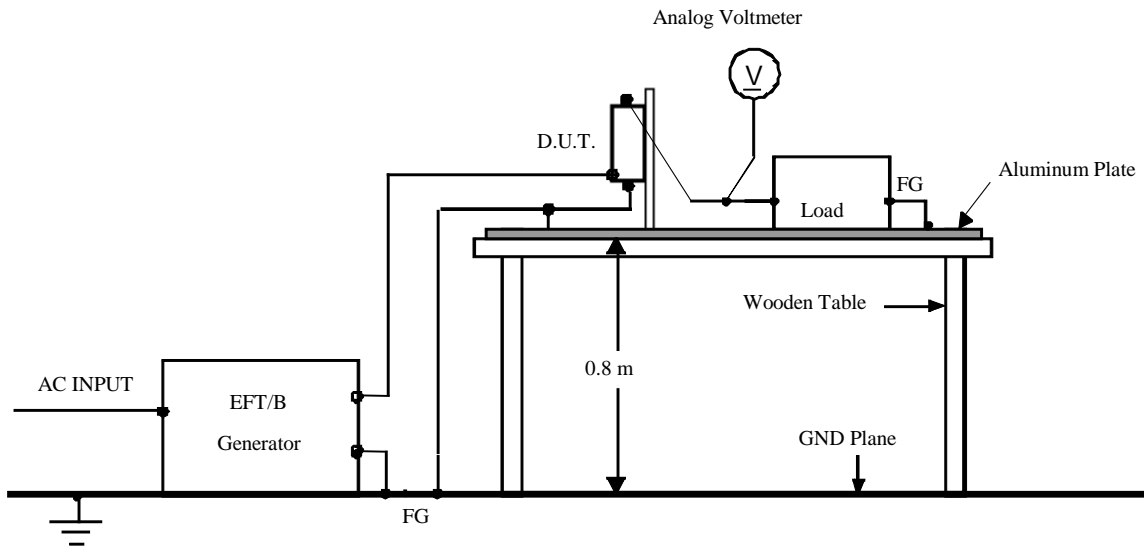

**(4) Acceptable Conditions**

1. Output voltage regulation not to exceed  $\pm 5\%$  of initial (before test) value during test.
2. Output voltage to be within regulation specification after the test.
3. Along with 1 and 2, no discharge of fire or smoke, as well as no output failure.

**(5) Test Result**

Test Voltage (kV)	Repetition Rate (kHz)	DRF240-24-1
1.0	5.0	PASS
2.0	5.0	PASS

**4. Surge Immunity Test (IEC61000-4-5)**

**MODEL : DRF240-24-1**

**(1) Equipment Used**


Surge Generator : SRG6501 (SCHAFFNER)  
 Coupling Impedance : Common 12Ω Coupling Capacitance : Common 9μF  
 Normal 2Ω Normal 18μF

**(2) Test Conditions**

Input Voltage : 115VAC, 230VAC Output Voltage : Rated  
 Output Current : 0%, 100% Number of Tests : 5 times  
 Polarity : +, - Mode : Common, Normal  
 Phase : 0, 90, 270 deg Ambient Temperature : 25°C

**(3) Test Method and Device Test Point**

Apply to Common mode (N-FG, L-FG) and Normal mode (N-L).

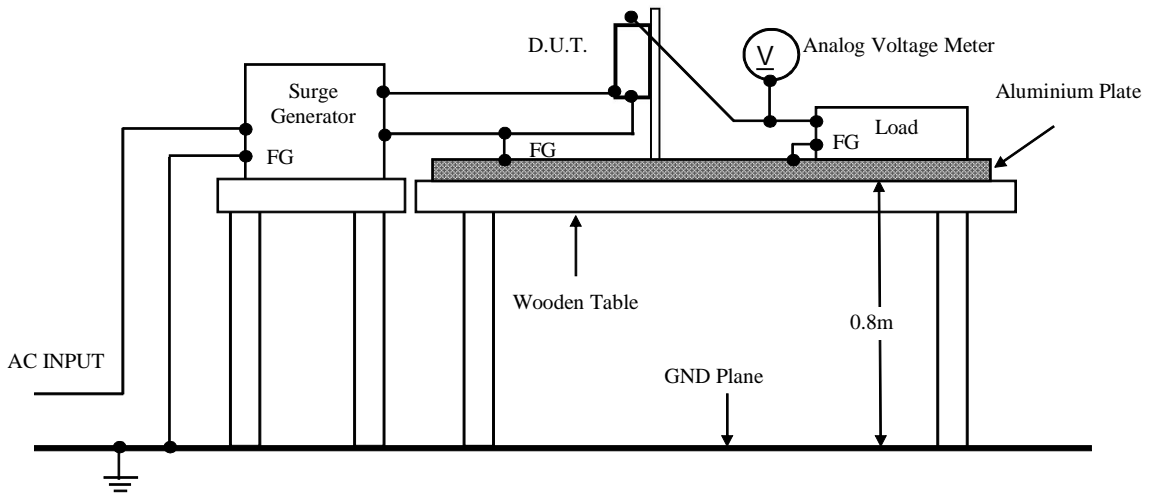

**(4) Acceptable Conditions**

1. Output voltage regulation not to exceed  $\pm 5\%$  of initial (before test) value during test.
2. Output voltage to be within regulation specification after the test.
3. Along with 1 and 2, no discharge of fire or smoke, as well as no output failure.


**(5) Test Result**

Test Voltage (kV) Common	DRF240-24-1	Test Voltage (kV) Normal	DRF240-24-1
1	PASS	1	PASS
2	PASS	2	PASS
4	PASS	-	-

**5. Conducted Disturbances Induced by Radio-Frequency Field Immunity Test (IEC61000-4-6)**

**MODEL : DRF240-24-1**

**(1) Equipment Used**

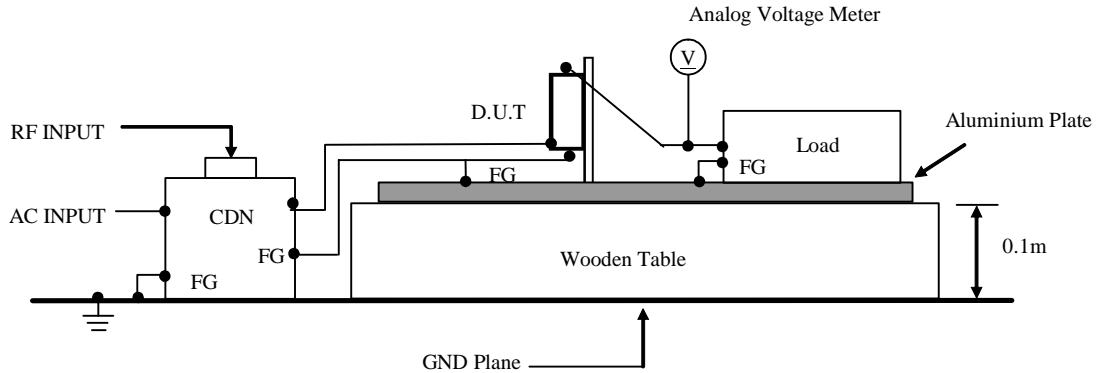

- Schaffner RF Generator : NSG-2070
- Schaffner Coupling and Decoupling Network (2/3-pin) : CDN M016
- Schaffner Immunity Injection Clamp : KEMZ801
- Schaffner 4dB/40W Attenuator : INA 2070-1

**(2) Test Conditions**

- Input Voltage : 230VAC
- Output Voltage : Rated
- Output Current : 100%
- Electromagnetic Frequency : 150kHz~80MHz
- Ambient Temperature : 25°C
- Sweep Conditions : 1.0% Step Up, 2.8 Seconds Hold

**(3) Test Method and Device Test Point**

**(4) Acceptable Conditions**

1. Output voltage regulation not to exceed  $\pm 5\%$  of initial (before test) value during test.
2. Output voltage to be within regulation specification after the test.
3. Along with 1 and 2, no discharge of fire or smoke, as well as no output failure.

**(5) Test Result**

Test Voltage (V)	DRF240-24-1
10	PASS

**6. Power Frequency Magnetic Field Immunity Test (IEC61000-4-8)**

**MODEL : DRF240-24-1**


**(1) Equipment Used**

Narda Magnetic Field Generator : 1008

**(2) Test Conditions**

Input Voltage	: 230VAC	Output Voltage	: Rated
Output Current	: 100%	Magnetic Frequency	: 50 Hz
Test Time	: > 10 sec (Each direction)	Ambient Temperature	: 25°C
Direction	: X, Y, Z		

**(3) Test Method and Device Test Point**

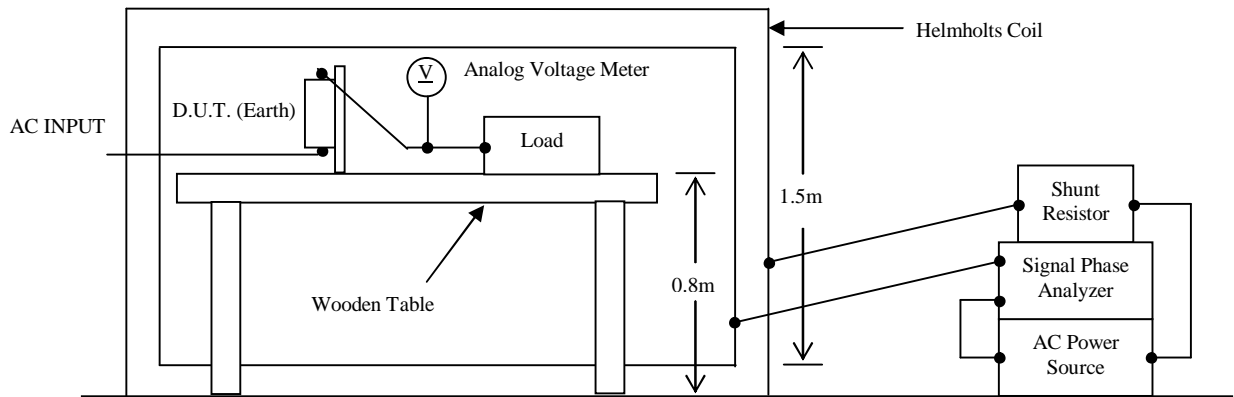

**(4) Acceptable Conditions**

1. Output voltage regulation not to exceed  $\pm 5\%$  of initial (before test) value during test.
2. Output voltage to be within output voltage regulation specification after the test.
3. Along with 1 and 2, no discharge of fire or smoke, as well as no output failure.

**(5) Test Result**

Magnetic Field Strength (A/m)	DRF240-24-1
30	PASS



**7. Voltage Dips, Short Interruptions Immunity Test (IEC61000-4-11)**

**MODEL : DRF240-24-1**


**(1) Equipment Used**

Test Generator : Programmable AC Source Model 61503 (CHROMA)

**(2) Test Conditions**

Input Voltage	: 230VAC	Output Voltage	: Rated
Output Current	: 100%	Ambient Temperature	: 25°C
Number of Tests	: 3 times	Test Interval	: > 10 sec.

**(3) Test Method and Device Test Point**

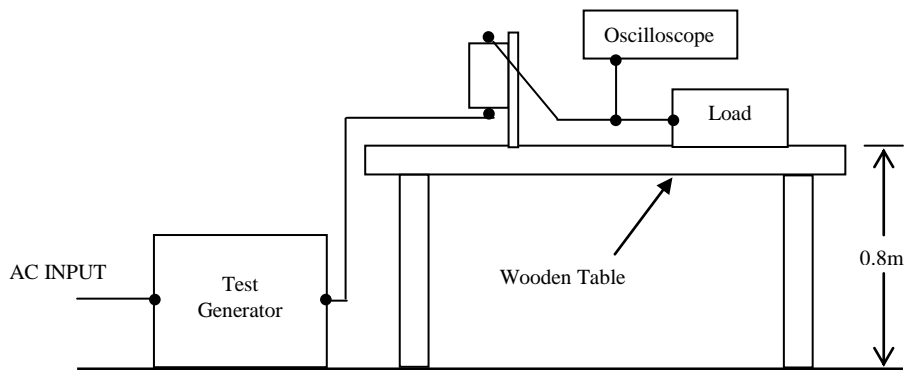

**(4) Acceptable Conditions**

At Test level 70%

1. Output voltage regulation not to exceed  $\pm 5\%$  of initial (before test) value during test.
2. Output voltage to be within output voltage regulation specification after the test.
3. Along with 1 and 2, no discharge of fire or smoke, as well as no output failure.

At Test level 40%, 0%

1. Output voltage to be within output voltage regulation specification after the test.
2. No discharge of fire or smoke.

**(5) Test Result**

Dip Rate	Continue Time	DRF240-24-1
30%	500ms	PASS
60%	200ms	PASS
100%	20ms, 5,000ms	PASS